


# SHP290 6 kW Heat Pump R290 Gas



SHP290 6 kW

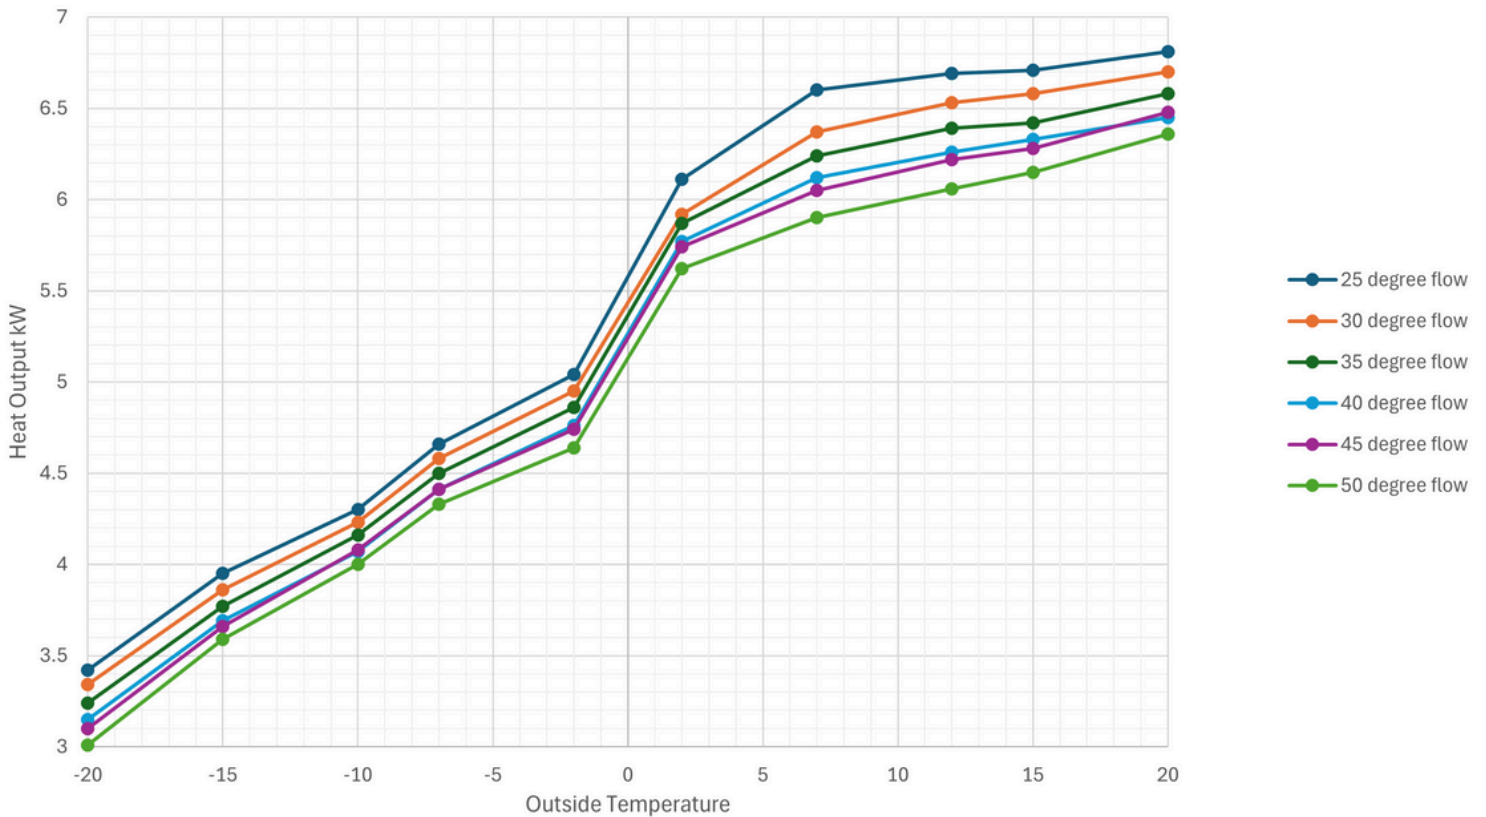

# SHP290 6 kW Heat Pump


## R290 Gas

Cooling		
Cooling capacity (1)	kW	5,8* / 5,4
Power input (1)	kW	2,0
E.E.R. (1)	W/W	2,8
Cooling capacity (2)	kW	6,2* / 5,62
Power input (2)	kW	1,25
E.E.R. (2)	W/W	4,49
SEER (5)	W/W	4,8
Water flow rate (1)	L/s	0,3
Useful head (1)	kPa	66
Heating		
Heating capacity (3)	kW	6,9* / 6,24
Power input (3)	kW	1,31
C.O.P. (3)	W/W	4,76
Heating capacity (4)	kW	6,4* / 6,0
Power input (4)	kW	1,9
C.O.P. (4)	W/W	3,1
Heating capacity (11)	kW	6,41* / 5,9
Power input (11)	kW	2,3
C.O.P. (11)	W/W	2,6
SCOP (6)	W/W	4,7
Water flow rate (3)	L/s	0,3
Useful head (3)	kPa	63
Energy efficiency (Water 35°C-65°C)		A+++/A++

Compressor		
Type	n°	Twin Rotary DC Inverter
Compressors	n°	1
Refrigerant circuits	k	1
Refrigerant quantity (7)	g	0,43
Hydraulic circuit		
Plumbing fittings	inch	G1"
Minimum water volume (8)	L	65
Noise level		
Sound power (9)	dB(A)	57
Sound pressure at 1m distance (10) <sup>dB(A)</sup>		42
Electrical data		
Power supply		230V/1/50Hz
Maximum power input	kW	3
Maximum input current	A	14
Weight		
Shipping weight	kg	117

### SCOP-UK

Flow Temperature	SCOP
35°C	4.42
50°C	3.54
65°C	2.98

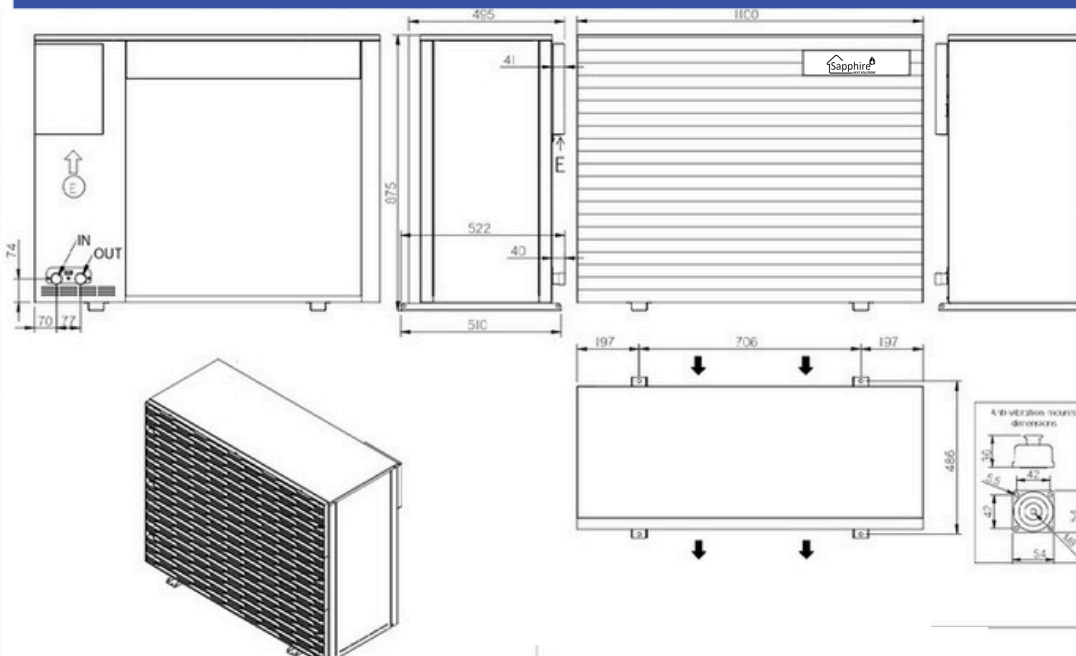

- PERFORMANCE REFERRING TO THE FOLLOWING CONDITIONS: 1. Cooling: outdoor air temperature 35°C; in/out water temperature 12/7°C. 2. Cooling: outdoor air temperature 35°C; in/out water temperature 23/18°C.
- 3. Heating: outdoor air temperature 7°C db 6°C db; in/out water temperature 30/35°C.
- 4. Heating: outdoor air temperature 7°C db 6°C db; in/out water temperature 47/55°C.
- 5. Cooling: low temperature, variable output, fixed flow rate.
- 6. Heating: average climatic conditions; T<sub>biv</sub> = -7°C; low temperature, variable output, fixed flow rate.
- 7. Indicative data subject to changes. For the correct value, always refer to the technical label on the unit.

- 8. Calculated for a decrease in system water temperature of 10°C with a defrost cycle lasting 6 minutes.
- 9. Sound power: heating mode according to EN 12102:2022; value determined on the basis of measurements made in accordance with UNI EN ISO 9614-1, in compliance with Eurovent certification requirements.
- 10. Sound pressure: value calculated from the sound power level using the standard ISO 3744:2010 at a distance of 1 m.
- 11. Heating: outdoor air temperature 7°C db 6°C db; in/out water temperature 55/65°C.